

Groundwater Treatment Plant - Treated Groundwater Volumes


The amount of groundwater treated is determined by measuring the number of gallons of treated water returned to LHAAP-18/24, released to the INF Pond, or discharged to Harrison Bayou.

Treated Water Data (in gallons)

Oct-07	Nov-07	Dec-07	Jan-08	Feb-08	Mar-08	Apr-08	May-08	Jun-08	Jul-08	Aug-08	Sep-08
1,041,491	848,356	804,822	792,148	665,883	818,872	791,306	568,812	776,904	748,377	690,052	617,199
Oct-08	Nov-08	Dec-08	Jan-09	Feb-09	Mar-09	Apr-09	May-09	Jun-09	Jul-09	Aug-09	Sep-09
655,059	619,274	726,118	552,299	598,144	433,800	488,807	526,958	387,644	0	414,853	735,716
Oct-09	Nov-09	Dec-09	Jan-10	Feb-10	Mar-10	Apr-10	May-10	Jun-10	Jul-10	Aug-10	Sep-10
808,322	636,306	727,492	391,898	695,343	802,656	894,731	962,121	1,257,977	1,314,924	1,041,495	1,136,547
Oct-10	Nov-10	Dec-10	Jan-11	Feb-11	Mar-11	Apr-11	May-11	Jun-11	Jul-11	Aug-11	Sep-11
956,567	705,805	849,712	811,679	668,281	1,090,348	817,325	900,338	916,552	784,369	652,524	733,456
Oct-11	Nov-11	Dec-11	Jan-12	Feb-12	Mar-12	Apr-12	May-12	Jun-12	Jul-12	Aug-12	Sep-12
748,102	658,250	684,903	865,453	725,000*	730,000*	980,000*	630,000*	0	0	0	349,012
Oct-12	Nov-12	Dec-12	Jan-13	Feb-13	Mar-13	Apr-13	May-13	Jun-13	Jul-13	Aug-13	Sep-13
617,037	607,610	560,436	869,710	751,213	641,708	699,776	746,885	392,719	962,890	843,913	716,057
Oct-13	Nov-13	Dec-13	Jan-14	Feb-14	Mar-14	Apr-14	May-14	Jun-14	Jul-14	Aug-14	Sep-14
813,974	727,442	706,416	552,657	738,691	844,095	811,346	972,913	611,505	626,253	573,601	575,376
Oct-14	Nov-14	Dec-14	Jan-15	Feb-15	Mar-15						
440,877	572,479	634,890	614,073	516,592	1,111,859						

*Indicates Estimate

Water Treated Monthly from January 2009 through March 2015

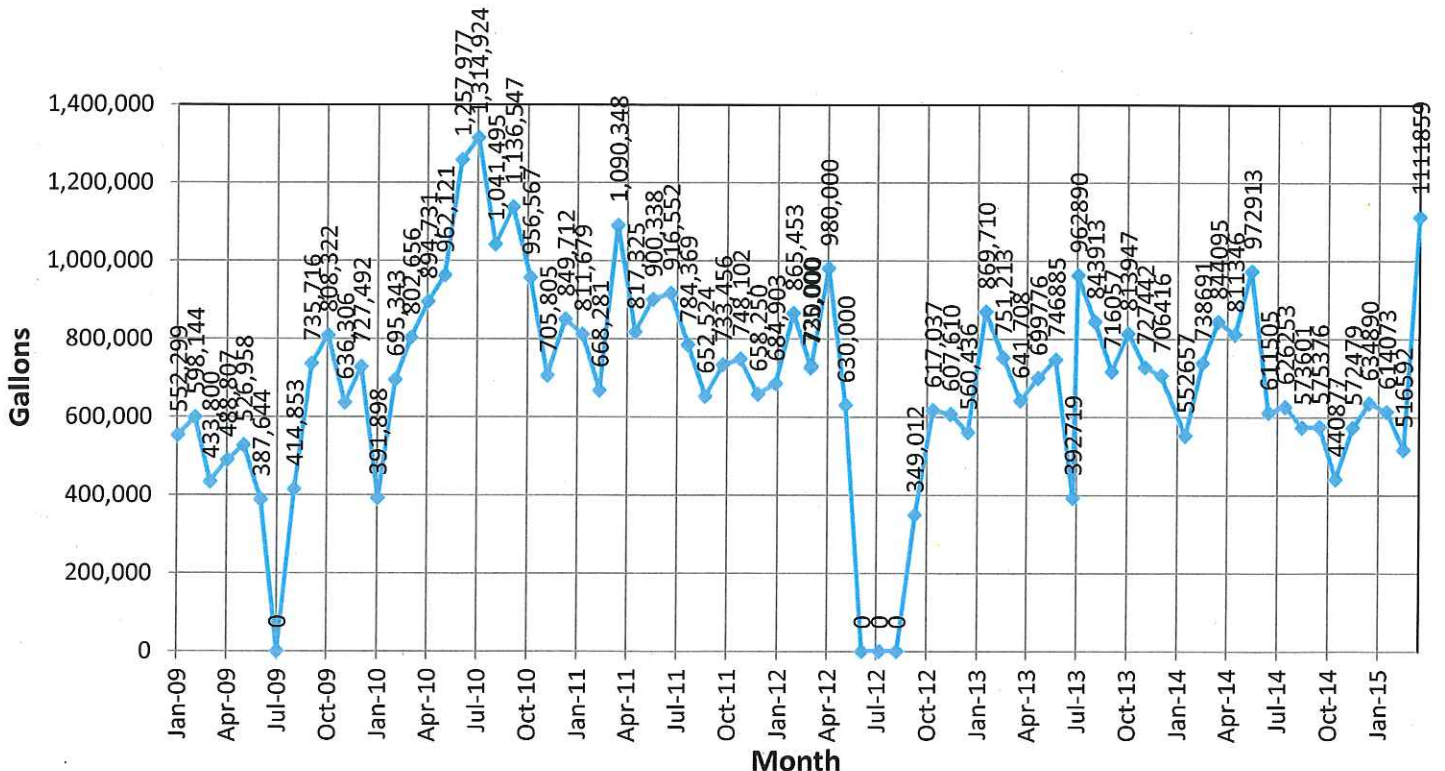


The pounds of chemicals removed for the 1st Quarter of 2015 can be found below and are calculated by the following formula:

$$\frac{(\text{GWTP Influent Contaminant Concentration } [\mu\text{g/L}] \times \text{Volume } [\text{gallons}] \times 3.785 \text{ [liters per gallon]})}{(453,600,000 \mu\text{g per pound})}$$

Pounds of Chemicals Removed From LHAAP-18/24, 1st Quarter 2015

	Trichloroethylene	Methylene Chloride	Perchlorate
Jan-15	46.9	0.155	96.8
Feb-15	41.3	1.05	66.8
Mar-15	71.8	8.28	114

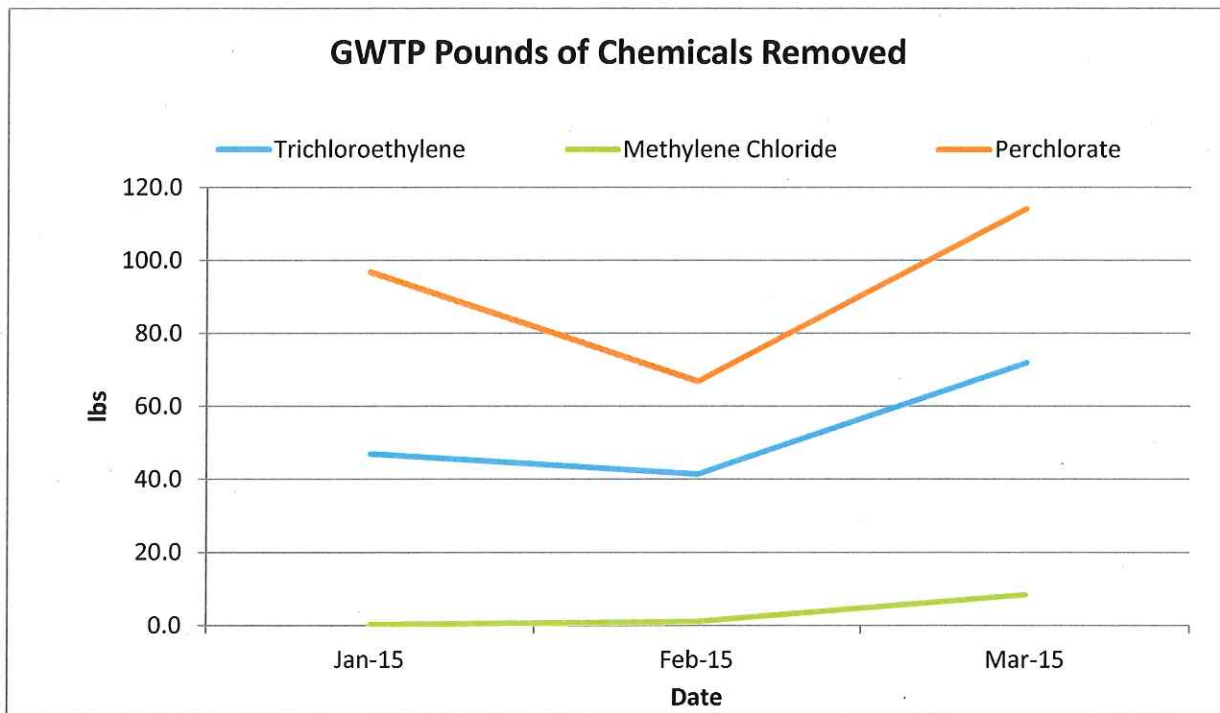

Water Discharge Location and Volume (Gallons)

Month	Harrison Bayou	LHAAP-18/24 Sprinklers	INF Pond
Jan-15	0	510,525	0
Feb-15	0	422,829	0
Mar-15	0	939,784	0