

RAB Meeting

LHAAP 18/24

Groundwater Treatment Plant Operations

Longhorn Army Ammunition Plant

1st Quarter 2011

June 30, 2011


6:30 pm

Karnack Community Center

Karnack, Texas

How much water was extracted from January through March?

Total of 1,265,157 gallons of water extracted from LHAAP-18/24 and LHAAP-16

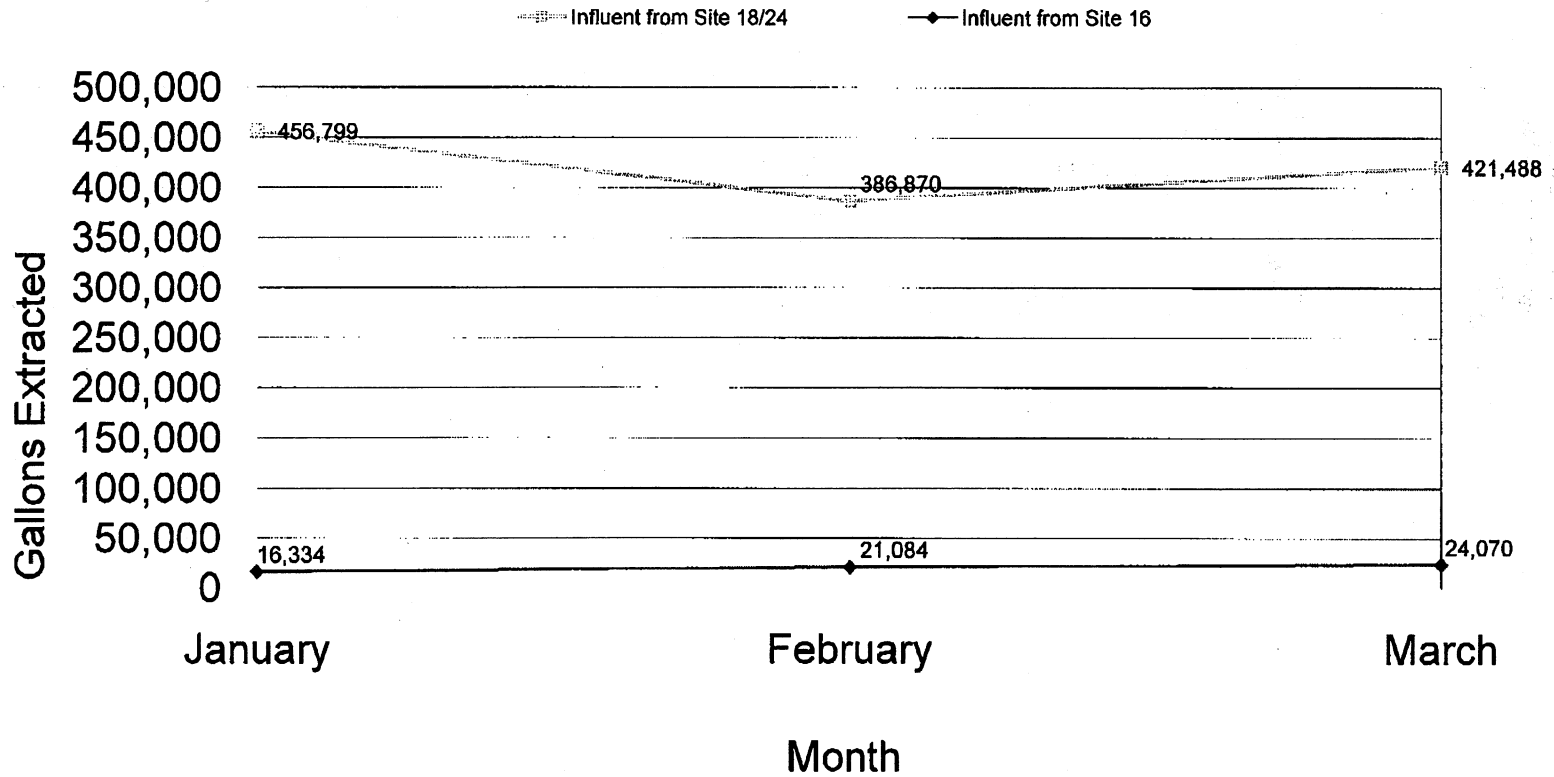


85M102006D

 **Shaw** a world of Solutions™


The Shaw Group Inc.®

How much water was processed?

How much water was processed?
Total treated water in last quarter was 2,570,308 gallons
(treated water is more than extracted due to added process water and rainwater)

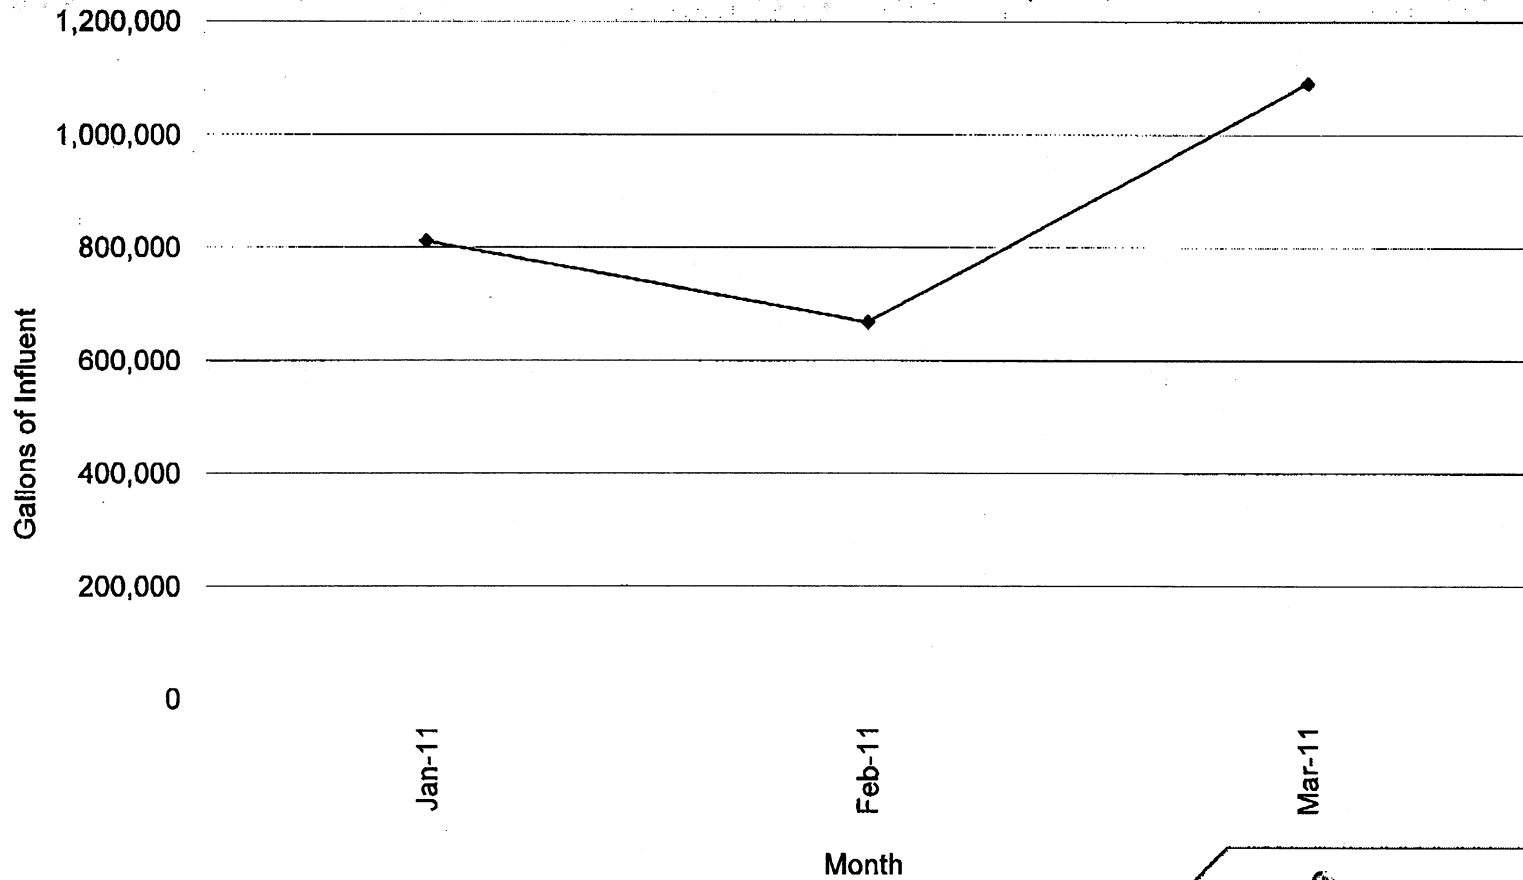

85M10206D

 **Shaw**® a world of Solutions™

The Shaw Group Inc.™

Where and how much treated water was discharged last quarter?

Where and how much treated water was discharged last quarter?

- Typically treated water is discharged to Harrison Bayou and a portion of it is re-injected at LHAAP-18/24. No water released to INF Pond.
- Approximately 708,957 gallons were injected at LHAAP-18/24
- Approximately 1,171,913 gallons of treated water was discharged from GWTP to Harrison Bayou during the first quarter of 2011 when there was enough flow in the bayou

85M10206D